

Rotary actuator for 2- and 3-way (control) ball valves

- Torque 10 Nm
- Nominal voltage AC/DC 24 V
- · Control: Open/close or 3-point



Technical data			
Electrical data	Nominal voltage		AC 24 V, 50/60 Hz / DC 24 V
	Nominal voltage range		AC 19,2 28,8 V / DC 21,6 28,8 V
	Power consumption	In operation	1.5 W @ nominal torque
		At rest	0.2 W
		For wire sizing	3.5 VA
	Connection		Cable 1 m, 3 x 0.75 mm ²
	Parallel connection		Possible, note performance data
Functional data	Torque (nominal torque)		Min. 10 Nm @ nominal voltage
	Manual override		Gearing latch disengaged with pushbutton, can be locked
	Running time		90 s / 90°∢
	Sound power level		Max. 35 dB (A) (without the valve)
	Position indication		Mechanical, pluggable
Safety	Protection class		III Safety extra-low voltage / UL Class 2 Supply
	Degree of protection		IP54 in any mounting position
			NEMA 2, UL Enclosure Type 2
	EMC		CE according to 2004/108/EC
	Certification		cULus according to UL 60730-1A and UL 60730-2-14 and CAN/CSA E60730-1:02
			and CAN/CSA E60/30-1:02 Certified to IEC/EN 60730-1 and IEC/EN 60730-2-14
	Mode of operation		Type 1
	Rated impulse voltage		0.8 kV
	Control pollution degree		3
	Ambient temperature		0 +50°C
	Media temperature		+5 +110°C in (control) ball valve
			-10°C with stem heating upon request
	Non-operating temperature Ambient humidity		−40 +80°C
			95% r.H., non-condensating
	Maintenance		Maintenance-free
Dimensions / Weight	eight Dimensions		See «Dimensions» on page 2
-	Weight		Approx. 750 g

Safety notes



- The actuator has been designed for use in stationary heating, ventilation and air conditioning systems and is not allowed to be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- It may only be installed by suitably trained personnel.

 All applicable legal or institutional installation regulations must be complied with.
- The switch for changing the direction of rotation may only be operated by authorized personnel. The direction of rotation must not be reversed in a frost protection circuit.
- The device may only be opened at the manufacturer's site. It does not contain any parts that can be replaced or repaired by the user.
- · The cable must not be removed from the device.
- The device contains electrical and electronic components and is not allowed to be disposed
 of as household refuse. All locally valid regulations and requirements must be observed.



Product features

Straightforward direct mounting on the ball valve with only one screw. The assembly tool is Simple direct mounting

integrated in the plug-on position indicator. The mounting position in relation to the ball valve can

Manual override with push-button possible (the gear is disengaged for as long as the button is Manual override

pressed or remains locked).

Adjustable angle of rotation Adjustable angle of rotation with mechanical end stops.

High functional reliability The actuator is overload-proof, requires no limit switches and automatically stops when the end

stop is reached.

Accessories

Electrical Accessories

Description	Data sheet
Auxiliary switch SA	T2 - SA
Feedback potentiometer P A	T2 - P. A.

Electrical installation


Wiring diagrams

Notes


- · Connect via safety isolation transformer.
- · Parallel connection of other actuators possible. Note performance data.
- · Direction of rotation switch is covered. Factory setting: Direction of rotation Y2.

Direction of rotation






Open-close control




3-point control



Dimensions [mm]


Dimensional drawings

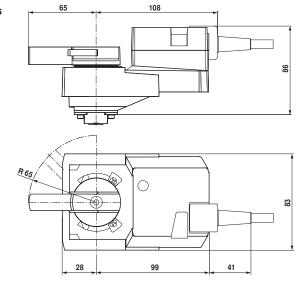



Further documentations


- · Complete overview «The comlete range of water solutions»
- · Data sheets for control ball valves
- Installation instructions for actuators and/or control ball valves
- · Notes for project planning (hydraulic characteristic curves and circuits, installation regulations, commissioning, maintenance etc.)




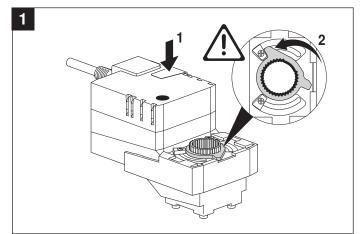


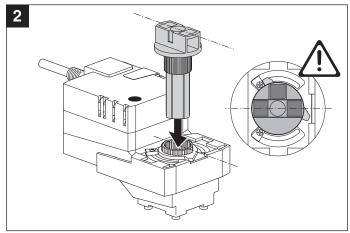


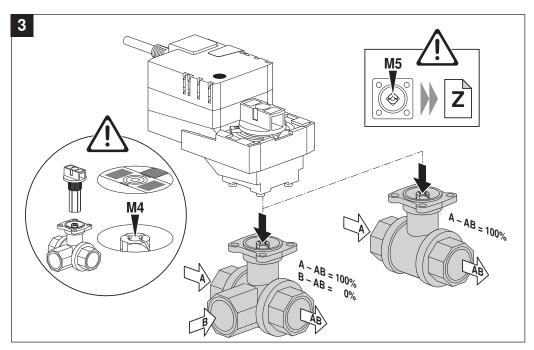

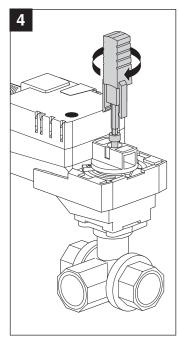


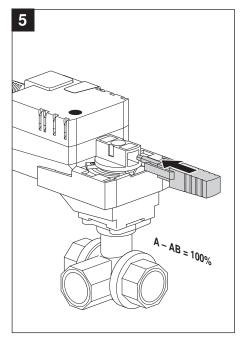



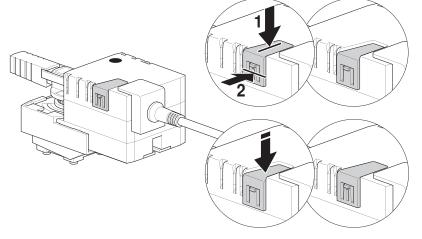



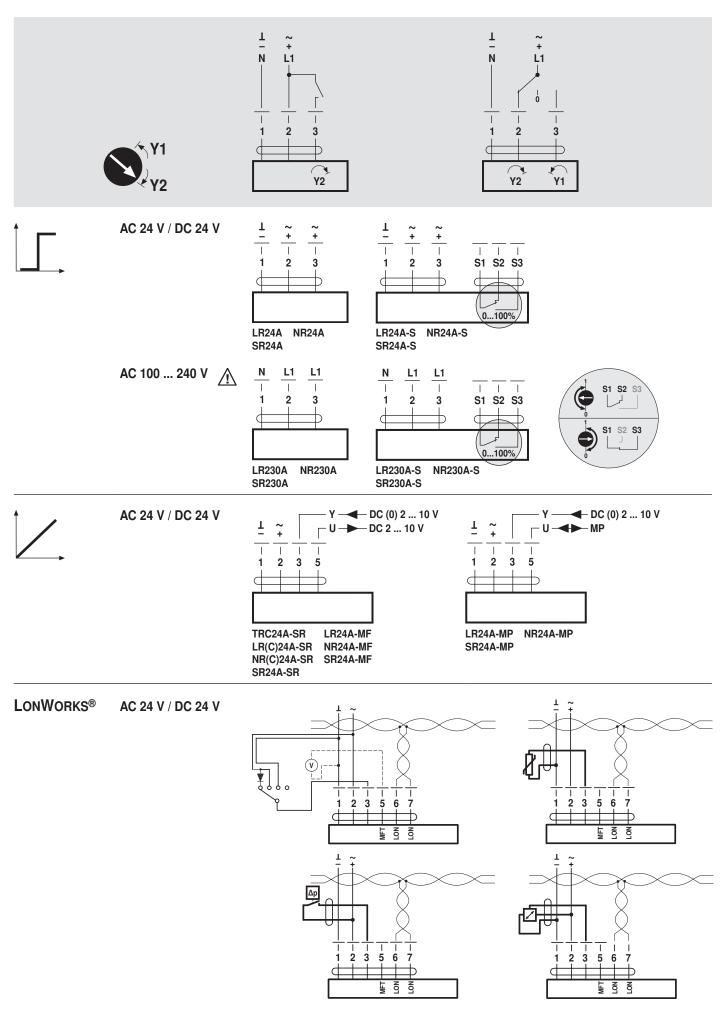



TR..A.. / LR..A.. / NR..A.. / SR..A..







